

- RTD, TC, Ohm, or mV input
- Extremely high measurement accuracy
- HART® communication
- Galvanic isolation
- For DIN form B sensor head mounting



Application






- Linearised temperature measurement with Pt100...Pt1000, Ni100...Ni1000, or TC sensor.
- Difference or average temperature measurement of 2 resistance or TC sensors.
- Conversion of linear resistance variation to a standard analogue current signal, for instance from valves or Ohmic level sensors.
- Amplification of a bipolar mV signal to a standard 4...20 mA current signal.
- Connection of up to 15 transmitters to a digital 2-wire signal with HART® communication.

Technical characteristics


- Within a few seconds the user can program HA to measure temperatures within all ranges defined by the norms.
- The RTD and resistance inputs have cable compensation for 2-, 3- and 4-wire connection.
- The HA has been designed according to strict safety requirements and is thus suitable for application in SIL 2 installations.
- Continuous check of vital stored data for safety reasons.
- Sensor error detection according to the guidelines in NAMUR NE 89.

Mounting / installation

- For DIN form B sensor head mounting.
- **NB:** As Ex barrier we recommend 5106B.

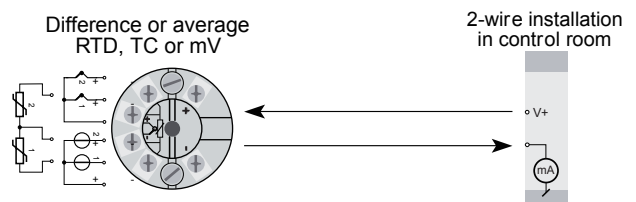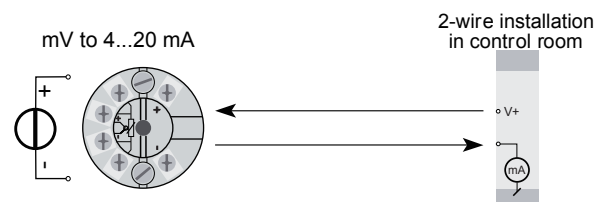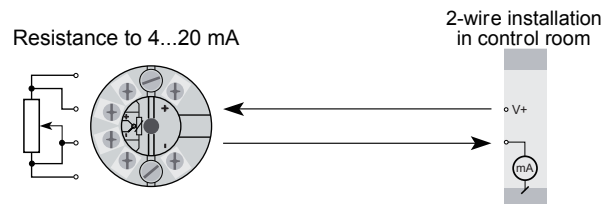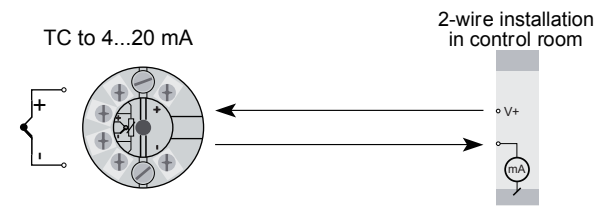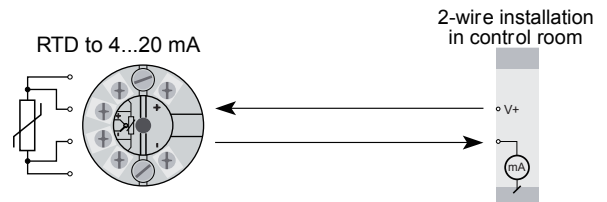

Connections

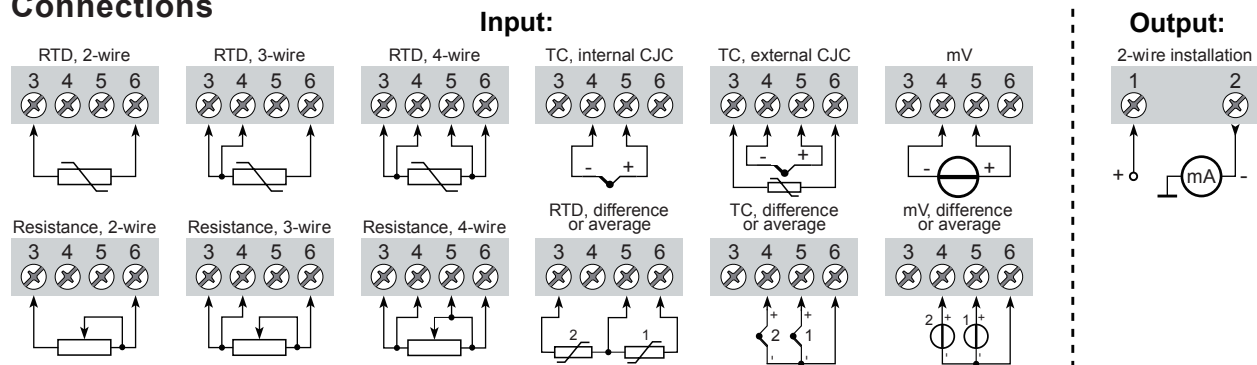

Electrical specifications

Specifications range:

-40°C to +85°C

Common specifications:

Supply voltage 8.0...30 VDC
 Voltage drop 8.0 VDC
 Isolation voltage, test / operation 1.5 kVAC / 50 VAC
 Communications interface Loop Link & HART®
 Signal / noise ratio Min. 60 dB
 Signal dynamics, input 22 bit
 Signal dynamics, output 16 bit
 Calibration temperature 20...28°C
 Accuracy, the greater of general and basic values:

General values		
Input type	Absolute accuracy	Temperature coefficient
All	$\leq \pm 0.05\%$ of span	$\leq \pm 0.005\%$ of span / °C

Basic values		
Input type	Basic accuracy	Temperature coefficient
Pt100 and Pt1000	$\leq \pm 0.1^\circ\text{C}$	$\leq \pm 0.005^\circ\text{C}/^\circ\text{C}$
Ni100	$\leq \pm 0.2^\circ\text{C}$	$\leq \pm 0.005^\circ\text{C}/^\circ\text{C}$
Lin. R	$\leq \pm 0.1 \Omega$	$\leq \pm 5 \text{ m}\Omega / ^\circ\text{C}$
Volt	$\leq \pm 10 \mu\text{V}$	$\leq \pm 0.5 \mu\text{V} / ^\circ\text{C}$
TC type: E, J, K, L, N, T, U	$\leq \pm 0.5^\circ\text{C}$	$\leq \pm 0.025^\circ\text{C} / ^\circ\text{C}$
TC type: B, R, S, W3, W5	$\leq \pm 1^\circ\text{C}$	$\leq \pm 0.1^\circ\text{C} / ^\circ\text{C}$

EMC immunity influence $< \pm 0.1\%$ of span
 Extended EMC immunity:
 NAMUR NE 21, A criterion, burst $< \pm 1\%$ of span

Vibration IEC 60068-2-6 Test FC
 Lloyd's specification no. 1 4 g / 2...100 Hz
 Humidity $< 95\%$ RH (non-cond.)
 Dimensions $\varnothing 44 \times 20.2 \text{ mm}$
 Protection degree (encl. / terminals) IP68 / IP00
 Electrical specifications, input:
 Max. offset 50% of select. max. value
 RTD and linear resistance input:

RTD type	Min. value	Max. value	Min. span	Standard
Pt100	-200°C	+850°C	10°C	IEC 60751
Ni100	-60°C	+250°C	10°C	DIN 43760
Lin. R	0 Ω	7000 Ω	10 Ω	-----

Cable resistance per wire (max.) 5 Ω
 Sensor current Nom. 0.2 mA
 Voltage input:
 Measurement range -800...+800 mV
 Min. span 2.5 mV
 Input resistance 10 M Ω

TC input:

Type	Min. temperature	Max. temperature	Min. span	Standard
B	+400°C	+1820°C	100°C	IEC584
E	-100°C	+1000°C	50°C	IEC584
J	-100°C	+1200°C	50°C	IEC584
K	-180°C	+1372°C	50°C	IEC584
L	-100°C	+900°C	50°C	DIN 43710
N	-180°C	+1300°C	50°C	IEC584
R	-50°C	+1760°C	100°C	IEC584
S	-50°C	+1760°C	100°C	IEC584
T	-200°C	+400°C	50°C	IEC584
U	-200°C	+600°C	50°C	DIN 43710
W3	0°C	+2300°C	100°C	ASTM E988-90
W5	0°C	+2300°C	100°C	ASTM E988-90

Cold junction compensation $< \pm 1.0^\circ\text{C}$

Current output:

Signal range 4...20 mA
 Min. signal range 16 mA
 Updating time 440 ms
 Load resistance $\leq (V_{\text{supply}} - 8) / 0.023 [\Omega]$

Sensor error detection:

Programmable 3.5...23 mA

Ex / I.S. approval:

KEMA 03ATEX1537 II 1 G Ex ia IIC
 T4 or T6
 II 1 D Ex ia D

Max. ambient temp. for T1...T4 85°C
 Max. ambient temp. for T5 and T6 60°C
 ATEX, applicable in zone 0, 1, 2, 20, 21 or 22

ATEX Installation Drawing No. 5335QE01

FM, applicable in IS, Class I, Div. 1,
 Group A, B, C, D
 IS, Class I, Zone 0,
 AEx ia IIC

FM Installation Drawing No. 5300Q502

CSA, applicable IS, Class I, Div. 1,
 Group A, B, C, D,
 Ex ia IIC
 IS, Class I, Zone 0,
 AEx ia IIC

CSA Installation Drawing No. 533XQC03

INMETRO 09/UL-BRCO-0002 BR-Ex ia IIC T4 or T6
 or -40°C $\leq T_{\text{amb.}} \leq +85^\circ\text{C}$,
 or -40°C $\leq T_{\text{amb.}} \leq +60^\circ\text{C}$

Observed authority requirements: Standard:

EMC 2004/108/EC EN 61326-1
 ATEX94/9/EC EN 60079-0, -11, -26
 EN 61241-0, -11

FM 3600, 3611, 3610
 CSA, CAN / CSA C22.2 No. 157,
 E60079-11, UL 913
 INMETRO IEC 60079-0, -11

Of span = Of the presently selected range